

ISS	REVISED BY:	REVISION DATE	ECD #

NOTES:


MATERIAL:
 HEAD - DUCTILE IRON, 40 KSI YIELD (HDG PER ASTM A153)
 CABLE - STEEL (GAC)
 CABLE SLEEVES - ALUMINUM
 THIMBLE - STEEL

DIMENSIONS: INCHES

MECHANICAL RATING:
 ANCHOR RATING WORKING LOAD (RWL) BASED ON INSTALLATION
 IN CLASS 5 SOIL (BLOW COUNT 24-40 PER ASTM D-1586),
 AND MIN. INSTALL DEPTH.

ULT (LB)	RWL (LB)	SOIL BEARING AREA (IN ²)	MIN INSTALL DEPTH (IN)
10,000	6,750	10.24	42

CABLE ULTIMATE BREAKING STRENGTH (GAC):
 1/4 (.25) 7,000 LBS

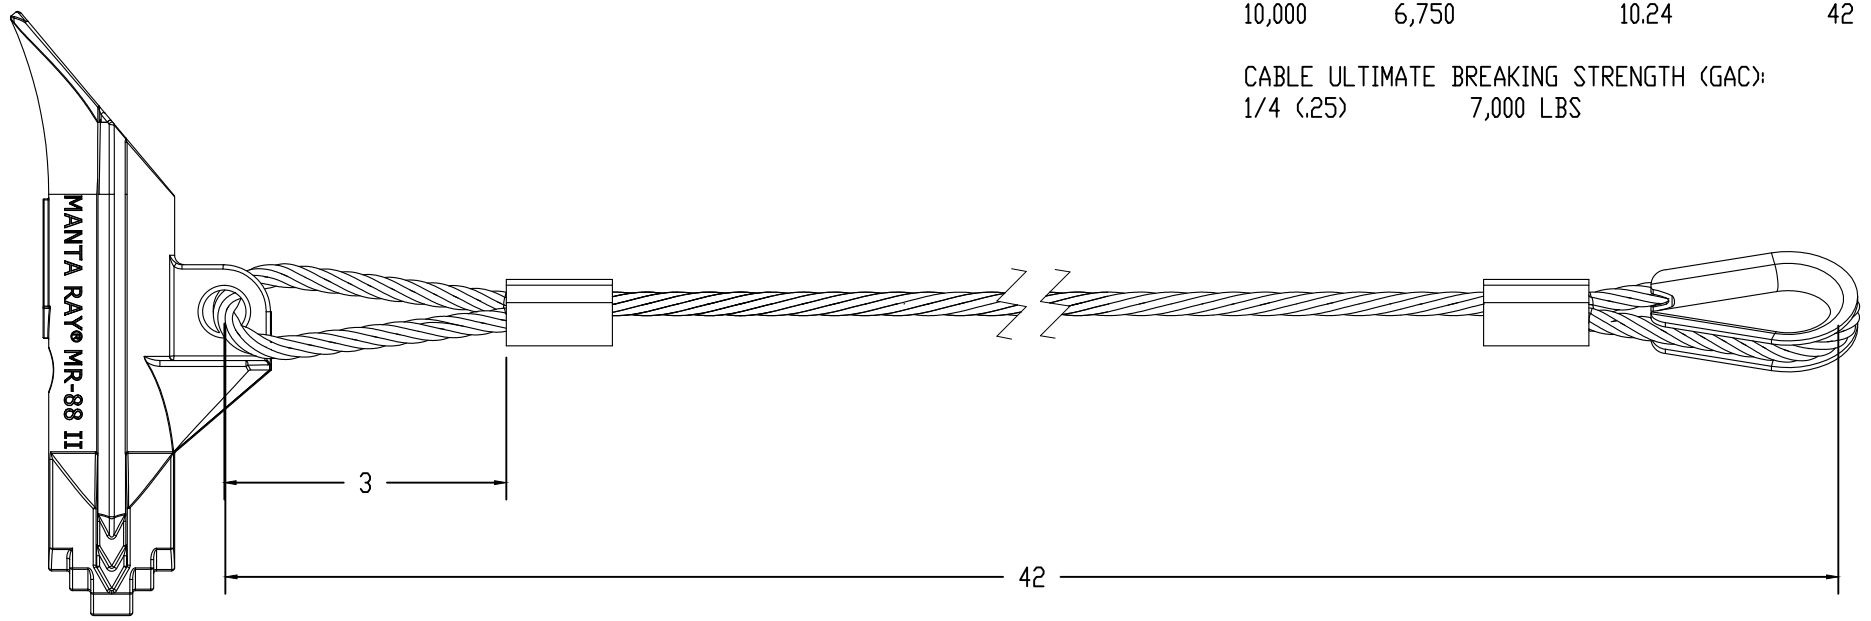

CATALOG NUMBER:			20091-II
SHEET NAME:		Sheet1	1 OF 1
DRAWING DESCRIPTION:			MR-88-CA1 ANCHOR/WIRE ASSEMBLY
DRAWN BY:	DH	DATE:	06/01/21
APPRVD:		DR	



MacLean
POWER SYSTEMS

WWW.MACLEANPOWER.COM

This drawing contains confidential information that is the property of MacLean Power, L.L.C. ("MacLean"). Use of MacLean's confidential information without MacLean's express written consent is strictly prohibited and may expose you to legal liability. If you believe that you received this material in error, please destroy it or return it to MacLean Power, L.L.C., Kingsley Park Five, 481 Munn Rd. Suite 300, Fort Mill, SC 29715, USA.